




## NEVADA LIQUEFIED PETROLEUM GAS BOARD

Post Office Box 338 • Carson City, Nevada 89702

(775) 687-4890 • [www.lpg.nv.gov](http://www.lpg.nv.gov)

### Fire Extinguisher Requirements for LP-Gas Installations

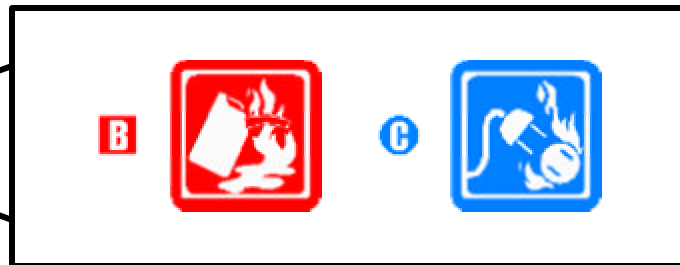

*The fire extinguisher must have a B:C rating.*

DRY CHEMICAL FIRE EXTINGUISHER  
NOMINAL FACTORY CHARGE: 20 LB.



*The fire extinguisher must be charged with a MINIMUM of 18 lbs. of dry chemical.*

**NFPA 58 (2001) 3.10.2.4** Each industrial plant, bulk plant, and distributing point shall be provided with at least one approved portable fire extinguisher having a minimum capacity of 18 lb (8.2 kg) of dry chemical with a B:C rating.